

FIRE MANUL CALL POINT

FA-507 manual pull stations provide a textured finger-hold area that includes Braille text. In addition to PUSH IN and PULL DOWN text, there are arrows indicating how to operate the station, provided for non-English-speaking people.

Pushing in and then pulling down on the handle activates the normally-open alarm switch. Once latched in the down position, the word "ACTIVATED" appears at the top in bright yellow, with a portion of the handle protruding at the bottom as a visible flag. Resetting the station is simple: insert the key or hex (model dependent), twist one quarter-turn, then open the station's front cover, causing the spring-loaded operation handle to return to its original position. The alarm switch can then be reset to its normal (non-alarm) position manually (by hand) or by closing the station's front cover, which automatically resets the switch.



SPECIFICATION

MECHANICAL


The push button panel is plastic material can reset.

Contact resistance	0.2ohm
Temp. range	-10 +50
Max. relative humidity	93RH 2%
Size	140x104x45mm
Color	Red

ELECTRICAL

Operation voltage	9-28VDC
Alarm. Current	<45mA

DIMENSIONS

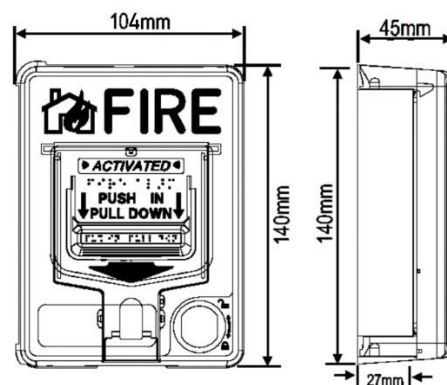

+91 9836838438
+033 29725520



glyptic.sales@gmail.com



Comm Off:- 1363 Naskarhat, Madhyapara,
Kolkata-700039, West Bengal
Reg Off:- Raipur, Bhita Burdwan-713102,
West Bengal, India